



**FÉDÉRATION EUROPÉENNE
DES SYNDICATS
D'ENTREPRISES D'ISOLATION**

EUROPEAN FEDERATION OF ASSOCIATIONS
OF INSULATION CONTRACTORS

FESI Document 11

**Problems of thermal stress in
metal reinforcements of large-
dimensional objects with
elevated service temperatures**

May 1998

zu beziehen : BFA Wärme-, Kälte-, Schall- und Brand-
to be ordered: schutz im Hauptverband der Deutschen
Bauindustrie e.V.
Kurfürstenstraße 129
D - 10785 BERLIN
Tel. (+49 30) 2 12 86-1 62
Fax: (+49 30) 2 12 86-2 97
e-mail: bfa.wksb@bauindustrie.de

Problems of thermal stress in metal reinforcements of large-dimensional objects with elevated service temperatures

Content

| | | |
|----|---|---|
| 1. | Problem..... | 2 |
| 2. | Principal considerations concerning the non-steady-state temperature distribution in reinforcing stiffeners | 2 |
| 3. | Example | 3 |
| 4. | Conclusions | 6 |

1. Problem

For the insulation of hot objects – especially large-dimensional ducts as found in nuclear power plants, flue gas desulphurisation and denitronisation systems –, it must be considered that reinforcing stiffeners on the duct wall always constitute thermal bridges. Two problems result:

- The increased thermal transmission through the thermal bridge leads to reduced temperatures at the inner surface of the duct wall. This may lead to going below the dew point temperature of the flue gas on that inner surface. This problem is not considered in this paper.
- With unacceptably high temperature differences between the inner and the outer edge of the stiffeners, thermal stress may result leading to distortion of profiles resulting in cracking of welded seams. For this reason, it is common to calculate maximum admissible temperature differences that are to be maintained through an appropriate construction and dimensioning of the insulation.

The limitation to the temperature differences demanded does not constitute a problem in steady-state service, i. e. with flue-gas temperatures not changing over time as long as the required insulation material coverage on the outside of the stiffeners – 1/3 s for stiffeners up to 100 mm, 2/3 s for stiffeners over 100 mm – is observed.

Difficulties, however, may occur in the non-steady-state service – where flue-gas temperature change over time as the installation is started up or shut down.

On starting up the installation, the temperature on the inner surface of the wall and the inner edges of the reinforcing stiffeners follows the increasing flue-gas temperature, whilst the outer edges of the stiffeners remain cold and the temperature there increases only after a considerable delay. This may lead to temperature differences substantially above those in steady-state service.

The magnitude of these “non-steady-state temperature differences” is dependent upon a variety of factors:

- The speed of temperature increase in the flue gas: the faster the installation started up, the higher the temperature difference.
- Size of the stiffeners: with big profiles and large masses, the temperature differences are higher than with small profiles.
- Shape of the reinforcing stiffeners.
- Thermal conductivity of the materials used.
- Thermal transmission conditions.

To lower the temperature differences, measures must be taken to allow for the movement of as much heat as possible through radiation and convection from the duct wall to the outer edge of the reinforcing stiffeners. This may be achieved – if technically feasible – by leaving an ample portion of the duct wall uninsulated.

These and other measures in the area of insulation are, however, of limited effect. With big reinforcing stiffeners, the steady-state temperature differences cannot be reduced to acceptable values even through “the best possible insulation”. Therefore, other measures – outside the control of the insulation trade – are required. Such measures could be e. g. to use several smaller stiffeners instead of one large one, or to reduce the rate of temperature increase when starting up the installation.

2. Principal considerations concerning the non-steady-state temperature distribution in reinforcing stiffeners

Depending upon the individual design, the temperature in reinforcing stiffeners is influenced by the shapes, and the appropriate insulation material design values.

Some observations of principle can be made for the design examples given in Figures 1 and 2.

The simple reinforcing fin (steel sheet; generally smaller than 100 mm) would generally have roughly equal temperatures at the inner and outer edges, providing the insulation material coverage d was sufficiently extensive (see chapter 1). In this case, no elevated thermal stress occurs. The “dew point temperature problem” on the inner surface of the duct wall, however, must also be considered in this case.

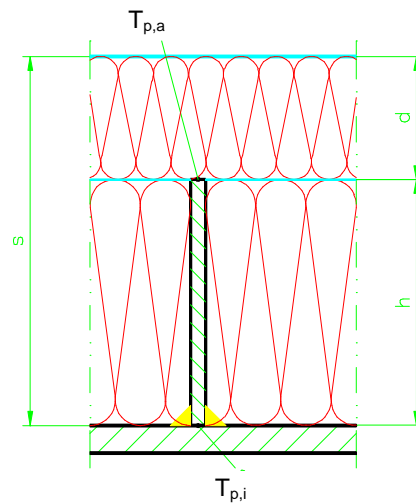


Figure 1

Contrary to this example, the temperature on the outer edge of the normally bigger I-profile (double T-profile – generally with webs exceeding 100 mm) definitely be lower than of the inner edge, since bigger masses must be heated on the outer edge and the heat transport requires more time due to the length of the web.

Frequently, the insulation contractor is required to prove mathematically temperature differences to be expected – normally calculated against known warming-up conditions in the start phase of the installation. Such calculations can be computed with numerical procedures such as the finite difference or the finite element method. However, it must be remembered that with these methods the thermal transmission inside the stiffener can be calculated satisfactorily exact, however, assumptions must be made regarding the movement of heat through radiation and convection, the precision of which is frequently very difficult to assess. This applies especially to radiation. Here, the surface conditions of the duct wall and the reinforcing stiffener are of decisive importance. They are not known to the insulation contractor with the precision required. Therefore, the declaration of warranties on the basis of such calculations should be cautioned against.

3. Example

For the insulation following the surface of the profile IPE 360 as in Figure 2a, some results of finite element calculations are given below. Figure 3 shows the temperature increase over time at an uninsulated duct wall, the inner and outer edges of the reinforcing flange when the warming-up transient is 1,6 K/min and 0,4 K/min.

The maximum occurring temperature differences for a profile IPE 400, insulated according Figure 2a, is given for different warming-up transient and for the steady-state service in Table 1.

Table 2 shows the maximum temperature differences for I-profiles, insulated with “air gaps” according to Figure 2b.

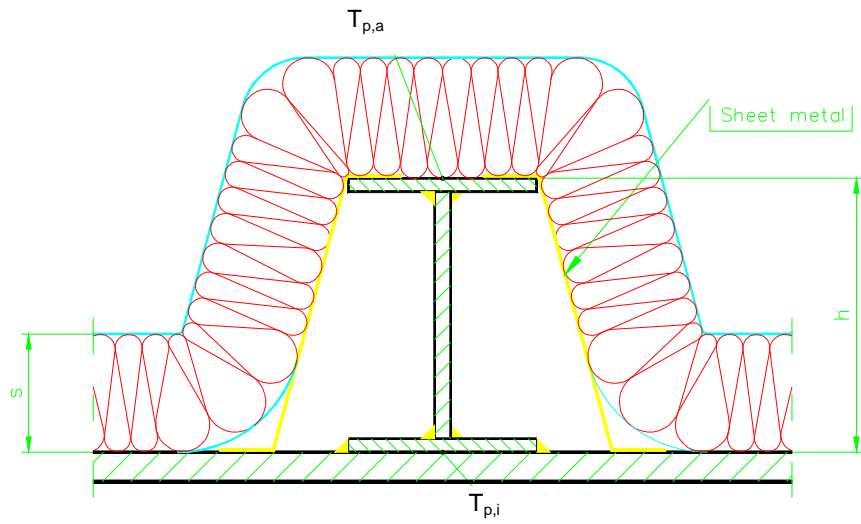


Figure 2a: Insulation following the surface

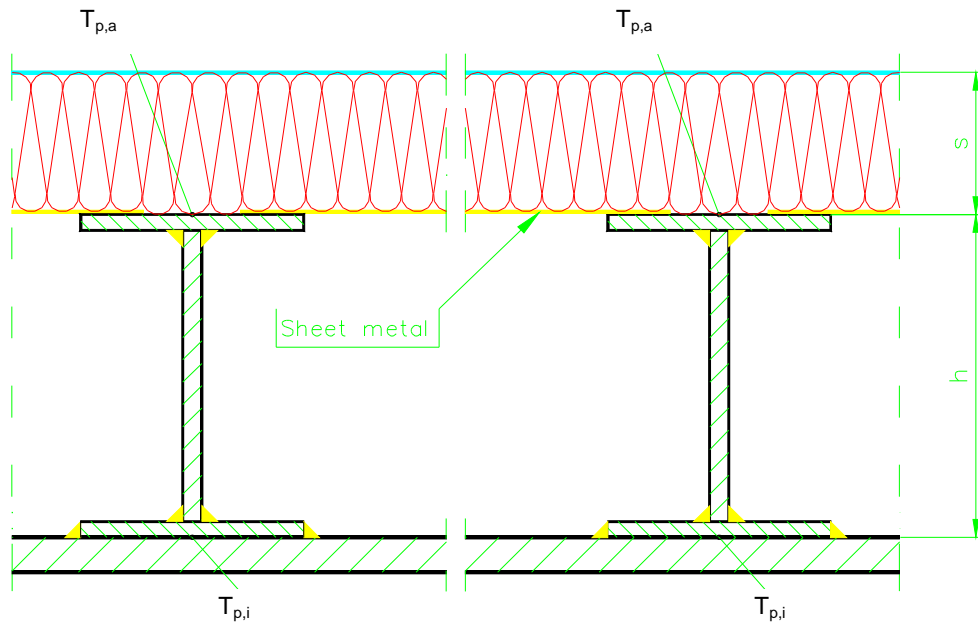
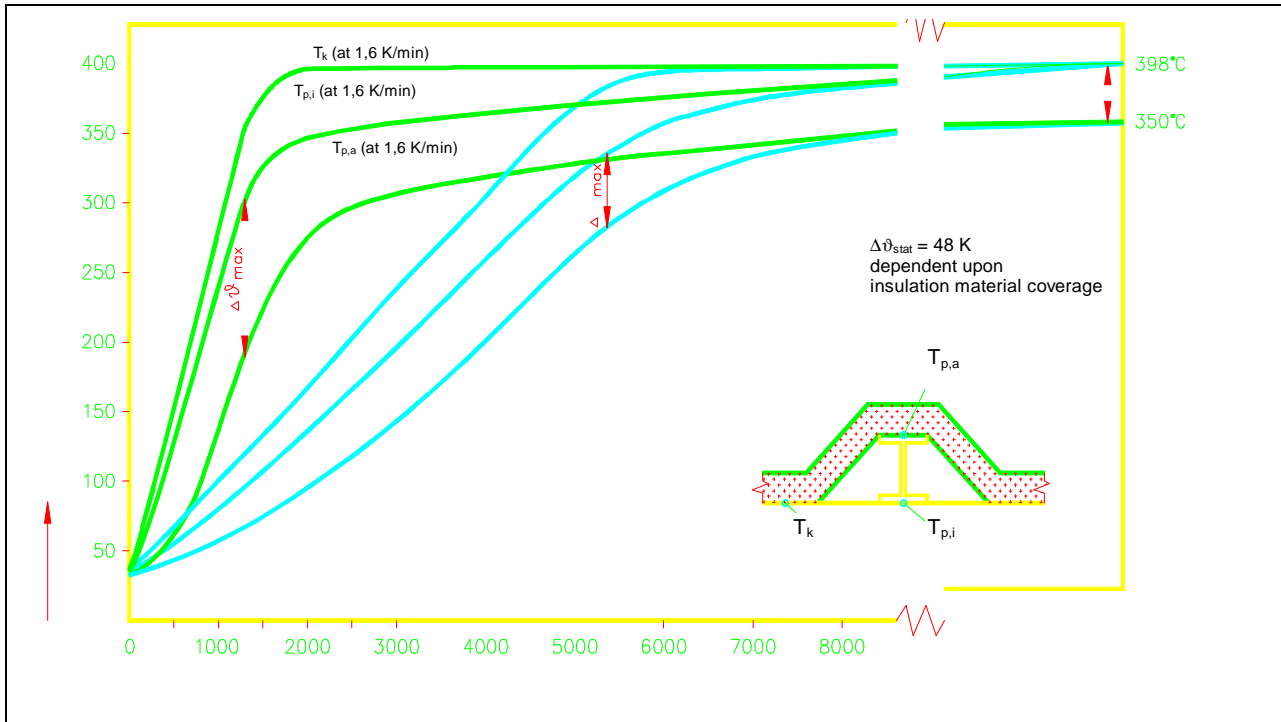


Figure 2b: Insulation with air gap



**Figure 3: Temperature increase over time with an IPE 360 profile
Warming-up transient 0,4 K/min and 1,6 K/min**

| STEADY-STATE | | NON-STEADY-STATE Initial temperature = +40 °C | | |
|--------------|--|--|---|---|
| Profile | Temperature difference in stiffeners = $\Delta\vartheta$ [K] | Profile | Temperature differences in stiffeners = $\Delta\vartheta$ [K] | Initial temperature K/min (temperature transient) |
| IPE 400 | about 35 | IPE 400 | 130 | 1,6 |
| | | - " - | 100 | 0,8 |
| | | - " - | 80 | 0,4 |
| | | - " - | 50-60 | 0,2 |

Table 1: Temperature differences in stiffeners with insulation following the surface (according to Figure 2a)

| STEADY-STATE | | NON-STEADY-STATE Initial temperature = +40 °C | | |
|--------------|--|--|---|---|
| Profile | Temperature difference in stiffeners = $\Delta\vartheta$ [K] | Profile | Temperature differences in stiffeners = $\Delta\vartheta$ [K] | Initial temperature K/min (temperature transient) |
| IPE 400 | about 10 | IPE 400 | about 50-60 | 1,6 |
| | | - " - | about 40 | 0,8 |
| | | - " - | 90 | 2,0 |
| IPE 400 | about 10 | IPE 460 | 75 | 1,6 |
| | | - " - | 50 | 0,8 |
| HEA 300 | about 10 | HEA 300 | 57 | 1,6 |
| | | - " - | 45 | 0,8 |
| IPE 370 | about 10 | IPE 370 | 53 | 1,6 |
| | | - " - | 34 | 0,8 |
| IPE 300 | about 10 | IPE 300 | 45 | 1,6 |
| IPE 270 | about 10 | IPE 270 | 42 | 1,6 |

Table 2: Temperature differences in flanges with "air-gap" insulation (according to Figure 2b)

The results show that especially whilst warming up the installation, critical stress maxima must be expected. The warming-up gradient has decisive influence here.

A comparison of the two designs considered here makes it obvious that the "air-gap" insulation compared to the surface-following insulation results in smaller temperature differences for both the steady-state and the non-steady-state conditions. These observations, however, only hold true when uncontrolled convection influence can be prevented.

4. Conclusions

For the insulation of large-dimensional hot objects, special thermal condition considerations are required. Additionally, investigation of the possible deformation in the stiffeners as a result of temperature differences is needed. This applies specifically to non-steady-state service conditions such as start-up and shut-down phases and accidents.

A mathematical proof of the maximum occurring thermal stresses in the steel construction of an object is not within the area of responsibility of the insulation contractor. The static system selected and the static and dynamic stresses to be born by the construction are in the area of responsibility of the installation contractor.

Nevertheless, this problem should be addressed when discussing contracts and the builder should be made aware of it. It could be possible that there is a duty to caution against possible damages, if the thermal stresses to be expected as result of the layout and size of the reinforcements and the temperature differences to be expected could lead to damages.

In critical cases, the necessity may even occur to ensure an even distribution of heat at the outer edges of the reinforcement in the warming-up phase of the installation by installing an extra heating system.

This FESI Document provides a general discussion of the technical issues mentioned therein. It does not replace detailed calculations and assessments of prevailing physical conditions in complicated building tasks. It is a publication of the Technical Commission of BFA WKSB in co-operation with the FESI Thermal Technical Commission and gives information about the status of technology at the moment of publication. Despite all circumspection employed in the editing work, a liability for possible mistakes cannot be accepted.

DISCLAIMER

The information contained in this document is considered by us to be good practice and industry guidance (Guidance). The Guidance is provided by a commission of FESI (www.fesi.eu), and is considered to be correct at the date of publication. Whilst we are confident the information contained within it is up to date and accurate, it is a reference document only. It is your responsibility to ensure your knowledge of the matters discussed in the Guidance is kept up to date.

The Guidance is intended to be used for general purposes only and is not intended to take precedence over appropriate national and international standards, guidelines or laws (where applicable). The Guidance is not intended to replace detailed calculations and assessments of prevailing physical conditions in complicated building assignments.

The Guidance does not constitute professional advice and specific queries should be referred to qualified professionals. Any reliance placed on the Guidance without seeking such advice is strictly at your own risk. We make no representations or warranties of any kind, express or implied, about the completeness, accuracy, reliability or suitability of the Guidance.

The Guidance in its original form is written in English. We accept no responsibility for any inaccuracies contained in any translation of the Guidance in languages other than English.

The Guidance is provided free of charge and as such in no event will we be liable for any loss or damage including, without limitation, indirect or consequential loss or damage, or any loss or damage whatsoever arising from any reliance placed on the Guidance. None of these exclusions or limitations, however, are intended to limit any rights which may not be excluded, nor to exclude or limit liability to you for death or personal injury resulting from our negligence or for other liability which we cannot exclude or limit by law.